| HYDRANT MAKE | MUELLER | KENNEDY |
|---|---|---|
| CAT No. | A-423 SUPER CENTURION 250 | GUARDIAN |

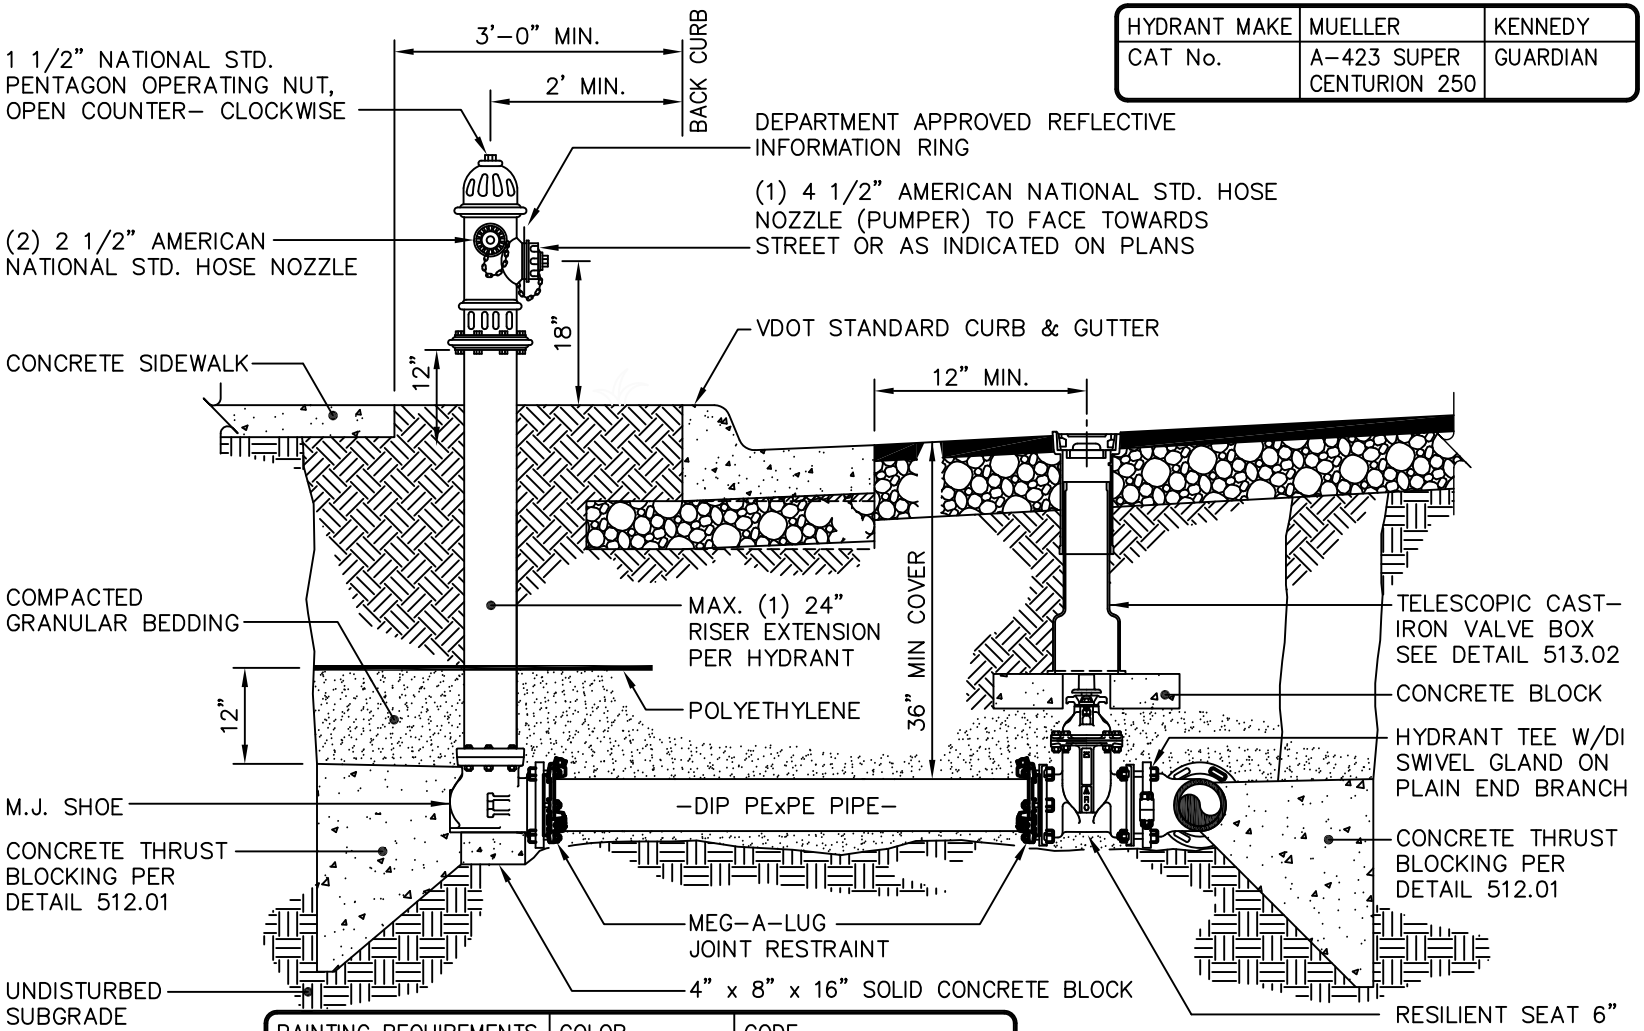


| PAINTING REQUIREMENTS | COLOR | CODE |
|---|---|---|
| BONNET | PURE WHITE | B54-W101-7907-99993 |
| BARREL | SAFETY RED | B54-R38-617-4064 |
| SHERWIN WILLIAMS OR APPROVED EQUAL (2 COATS) | | |

## NOTES:

1. Where hydrant is set behind guardrail, centerline of pumper nozzle to be a minimum of 12" and a maximum of 18" above top of guardrail. center of hydrant to be a minimum of 3 feet from guardrail.
2. Fire hydrant to be oiled & greased and cap to be sprayed (non-petroleum - based) after installation.
3. Do not locate hydrants in sidewalks or block pedestrian flow.
4. Fire hydrant to be a minimum of 5' from all entrances.


Department of Utilities
10455 Armstrong Street
Fairfax, VA 22030-3630


# FIRE HYDRANT BEHIND CURB APPLICATION

CITY of FAIRFAX

USE WITH THE FAIRFAX STANDARD SPECIFICATIONS ONLY


Voice (703) 385-7920
FAX (703) 934-8427
www.fairfaxva.gov


SCALE: Not To Scale

REVISION DATE: April 2010

DETAIL # 2 514.01

SHEET #: 1 of 1