HYDRANT MAKE	MUELLER	KENNEDY
CAT No.	A-423 SUPER CENTURION 250	GUARDIAN

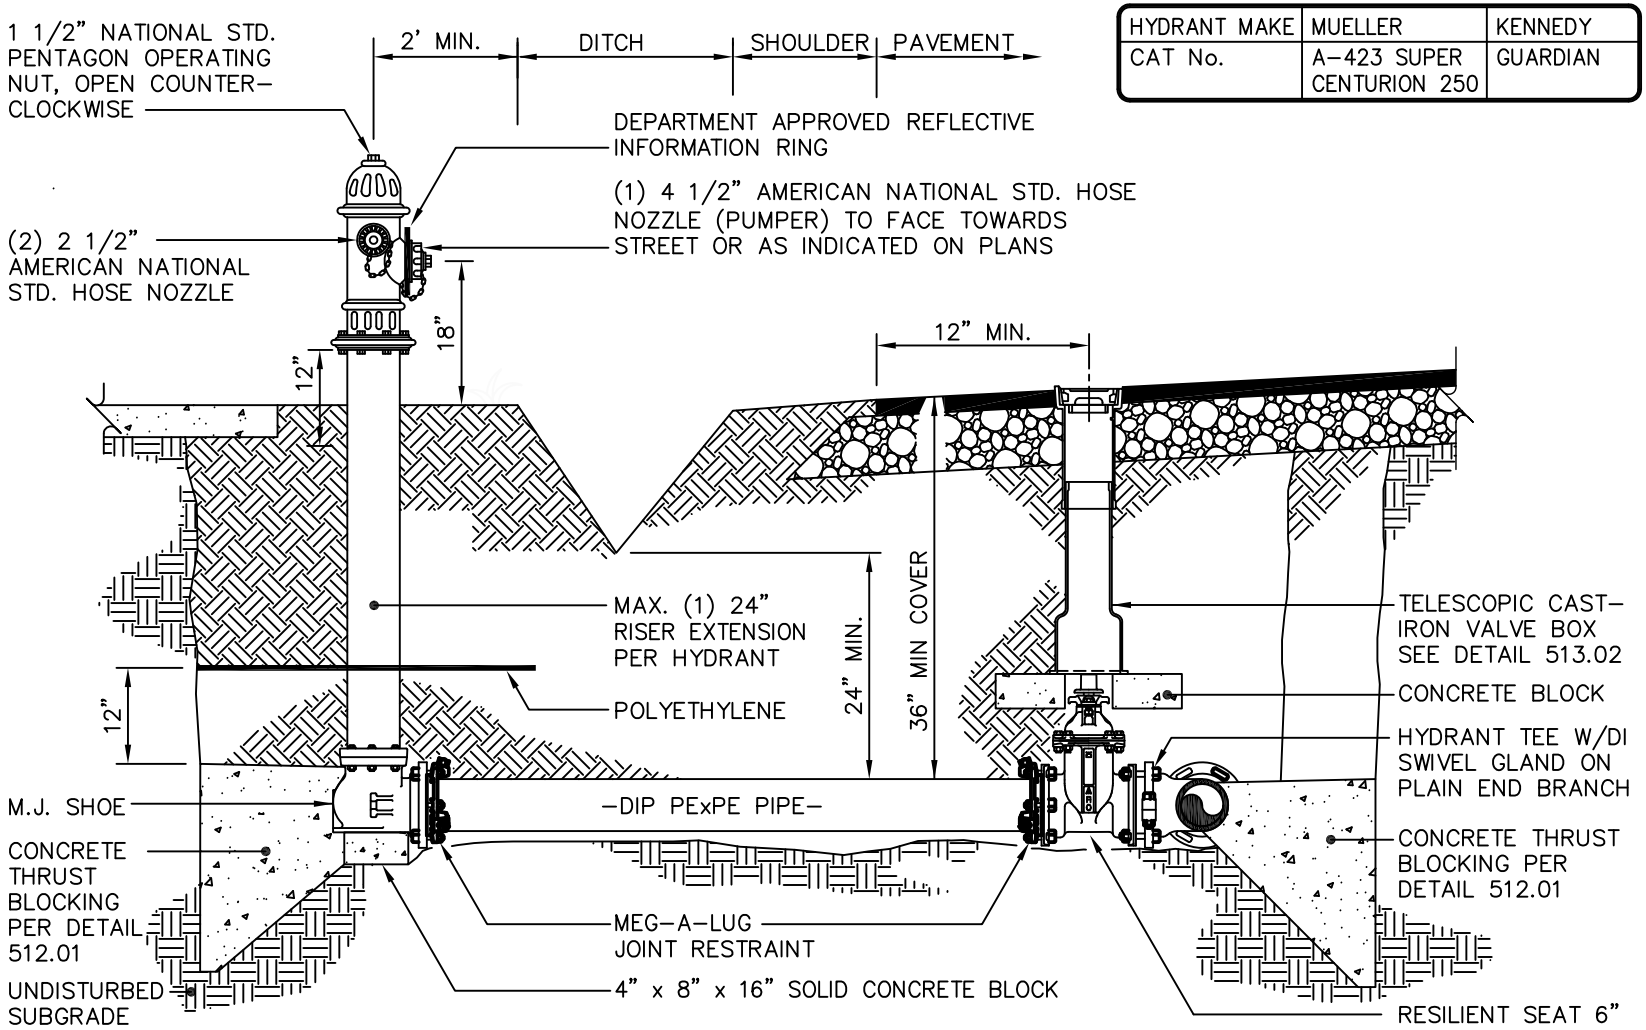

PAINTING REQUIREMENTS	COLOR	CODE
BONNET	PURE WHITE	B54-W101-7907-99993
BARREL	SAFETY RED	B54-R38-617-4064
SHERWIN WILLIAMS OR APPROVED EQUAL		

NOTES:

1. Where hydrant is set behind guardrail, centerline of pumper nozzle to be a minimum of 12" and a maximum of 18" above top of guardrail. center of hydrant to be a minimum of 3 feet from guardrail.
2. Fire hydrant to be oiled & greased and cap to be sprayed (non-petroleum - based) after installation.
3. Do not locate hydrants in sidewalks or block pedestrian flow.

Department of Utilities
10455 Armstrong Street
Fairfax, VA 22030-3630

FIRE HYDRAND
ROADSIDE DITCH APPLICATION

CITY of FAIRFAX

USE WITH THE FAIRFAX STANDARD SPECIFICATIONS ONLY

Voice (703) 385-7920
FAX (703) 934-8427
www.fairfaxva.gov

SCALE: Not To Scale

REVISION DATE: April 2010

DETAIL # 2 514.02

SHEET #: 1 of 1