


**BUS SHELTER INSTALLATION DETAIL** 

2409.01 Not To Scale REVISION DATE: SHEET #:

of

July, 2005

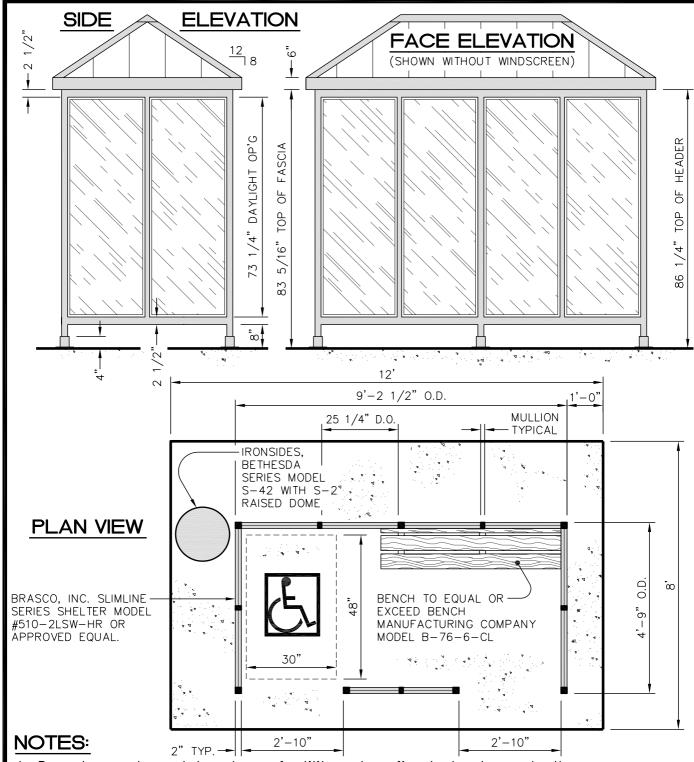

- 1. Bus stop pad must be clear of utility poles, fire hydrants, and other similar obstacles.
- 2. A 30"x36" map display panel is to be provided with shelter.
- 3. A Rugged Transit Display shelter sign shall be provided including mounting brackets, hardware, and power hook up. Mount as directed by City.



Department of Public Works 10455 Armstrong Street Fairfax, VA 22030-3630

## **CITY of FAIRFAX**

USE WITH THE FAIRFAX STANDARD SPECIFICATIONS ONLY

Voice (703) 246-6330 FAX (703) 591-5727 www.fairfaxva.gov

<b>BUS SHELTER</b>
INSTALLATION DETAIL

SCALE:	DETAIL#
Not To Scale	2409.01
REVISION DATE:	SHEET #:
July, 2005	2 of 2