


UNPAVED AREAS PAVED AREAS

NOTES:

1. Cleanout stack shall extend a minimum of 18" above grade for new construction until service is connected and/or finish grade is established cleanouts shall be installed at grade for existing services unless otherwise directed.
2. The full length of the service trench shall be compacted in 6" layers with mechanical tamp.
3. Wye, lateral, & c.o. assembly must be bedded in VDOT no. 57 stone. (see sanitary sewer line trench detail 4.01 for gravity mains.)

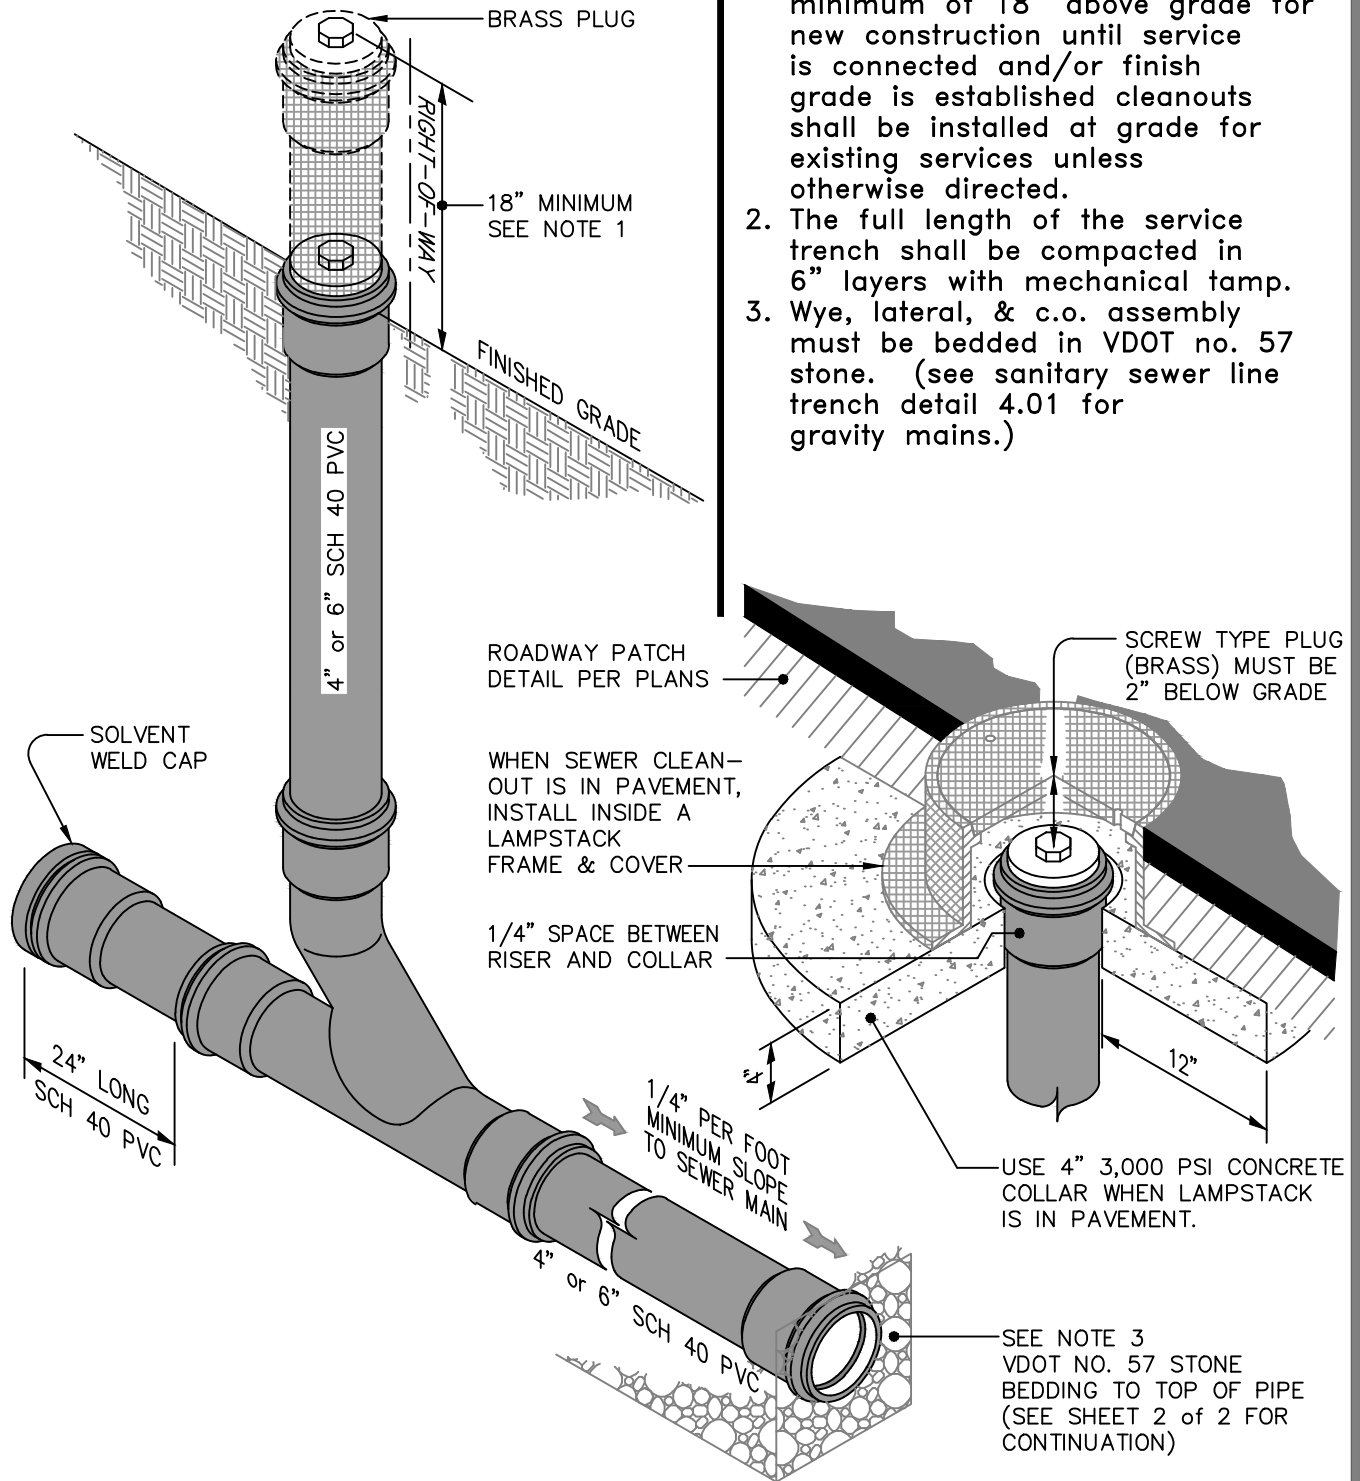

Department of Public Works
10455 Armstrong Street
Fairfax, VA 22030-3630


CITY of FAIRFAX

USE WITH THE FAIRFAX STANDARD SPECIFICATIONS ONLY

Voice (703) 385-7810
FAX (703) 591-5727
www.fairfaxva.gov

**TYPICAL PVC SEWER LATERAL
CLEANOUT WITH IN-LINE WYE**


SCALE: Not To Scale	DETAIL # 4.12
REVISION DATE: February 2017	SHEET #: 1 of 2

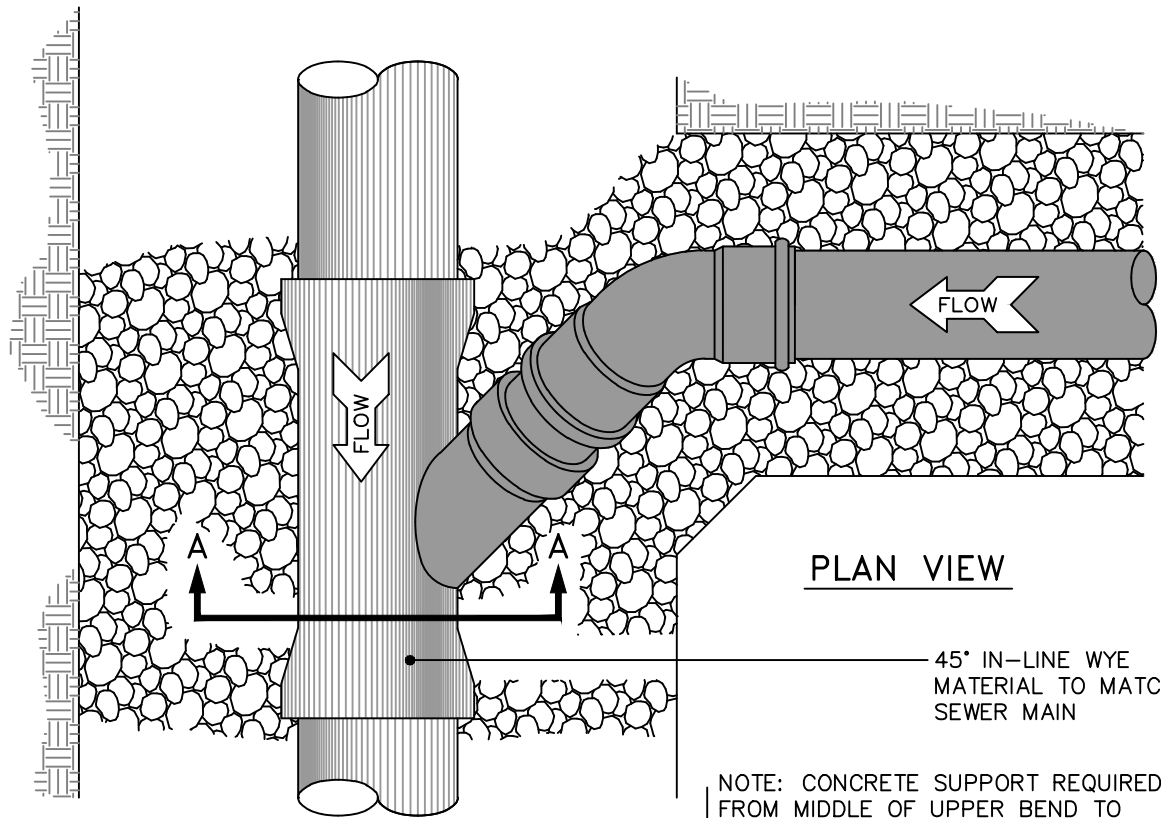

PLAN VIEW

45° IN-LINE WYE
MATERIAL TO MATCH
SEWER MAIN

NOTE: CONCRETE SUPPORT REQUIRED
FROM MIDDLE OF UPPER BEND TO
BASE OF MAIN

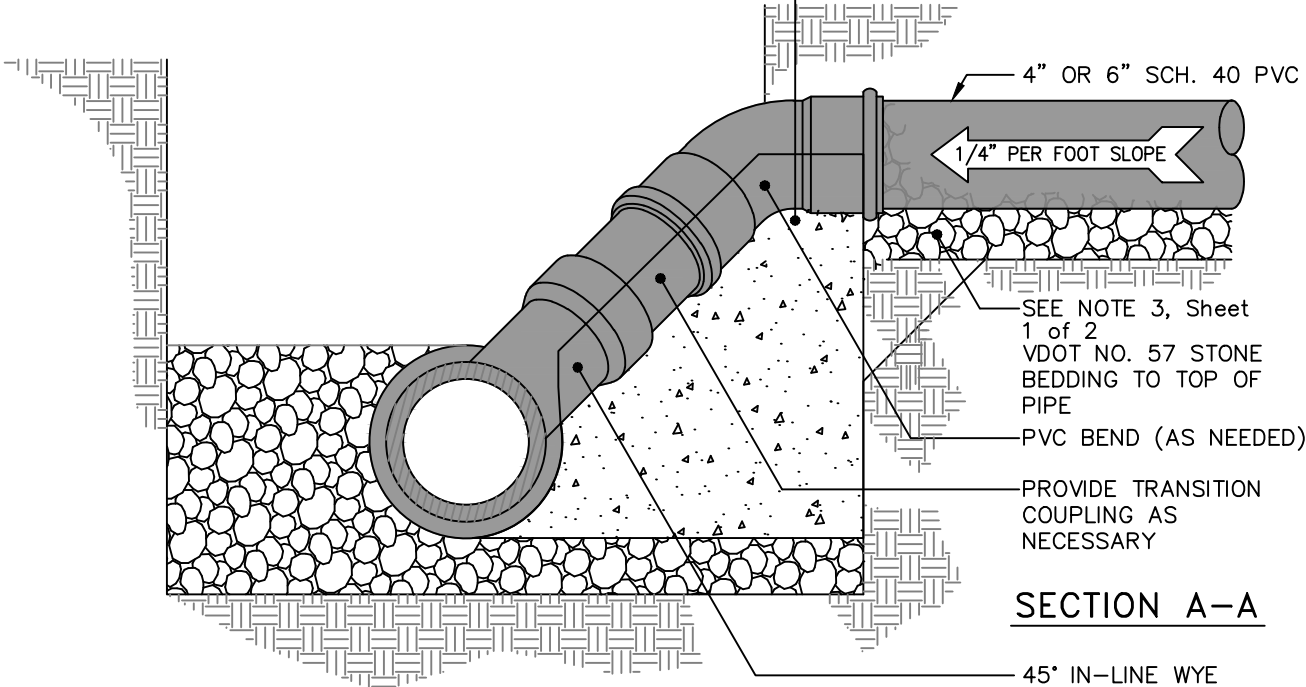

SECTION A-A

45° IN-LINE WYE
MATERIAL TO MATCH
SEWER MAIN



CITY of FAIRFAX

USE WITH THE FAIRFAX STANDARD SPECIFICATIONS ONLY

**TYPICAL PVC SEWER LATERAL
CLEANOUT WITH IN-LINE WYE**

SCALE: Not To Scale	DETAIL # 4.12
REVISION DATE: February 2017	SHEET #: 2 of 2